



GENERAL NOTES

1. THESE DETAILS REFER ONLY TO INSTALLATIONS ON FLEXIBLE PIPE MAINS. REFER TO OTHER APPROPRIATE STANDARDS FOR RIGID PIPE MAINS.
2. DETAIL "A" SHALL BE USED WHEN A TRENCH BOX, SHORING OR OTHER MEANS OF EXCAVATION BRACING IS USED, OTHERWISE IT SHALL BE THE CONTRACTOR'S OPTION TO USE EITHER DETAIL "A" OR DETAIL "B".
3. REFER TO SPECIFICATION SECTION 905 FOR MATERIAL REQUIREMENTS.
4. TRENCH SLOPES SHALL BE AS PER THE OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION (OSHA) STANDARDS.

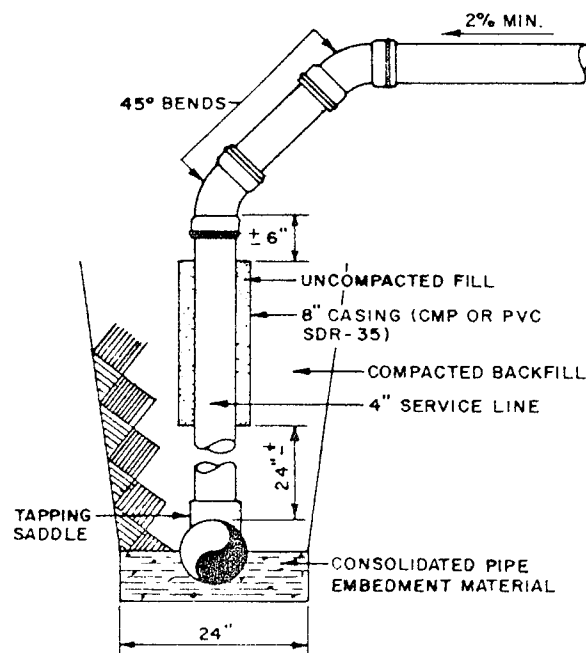

DETAIL "A"

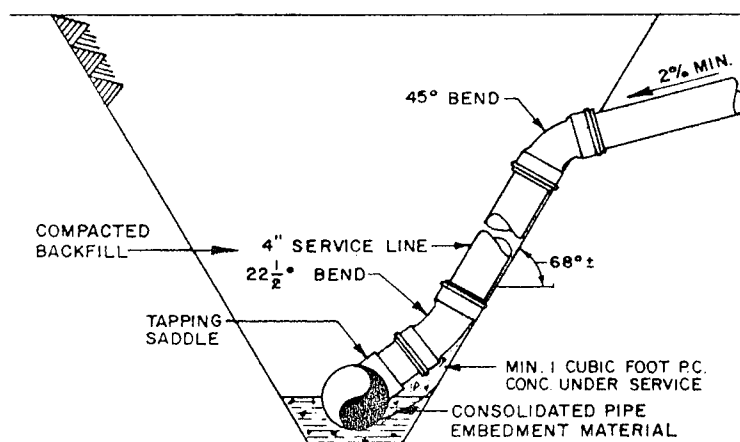

DETAIL "B"

<p>REVISIONS</p> <p>11-14-91</p>	CITY OF ALBUQUERQUE	
	<p>SEWER</p> <p>RISER DETAILS</p> <p>FLEXIBLE PIPE MAIN</p> <p>DWG. 2136</p> <p>AUG. 1966</p>	